


4FT+/-2INCH

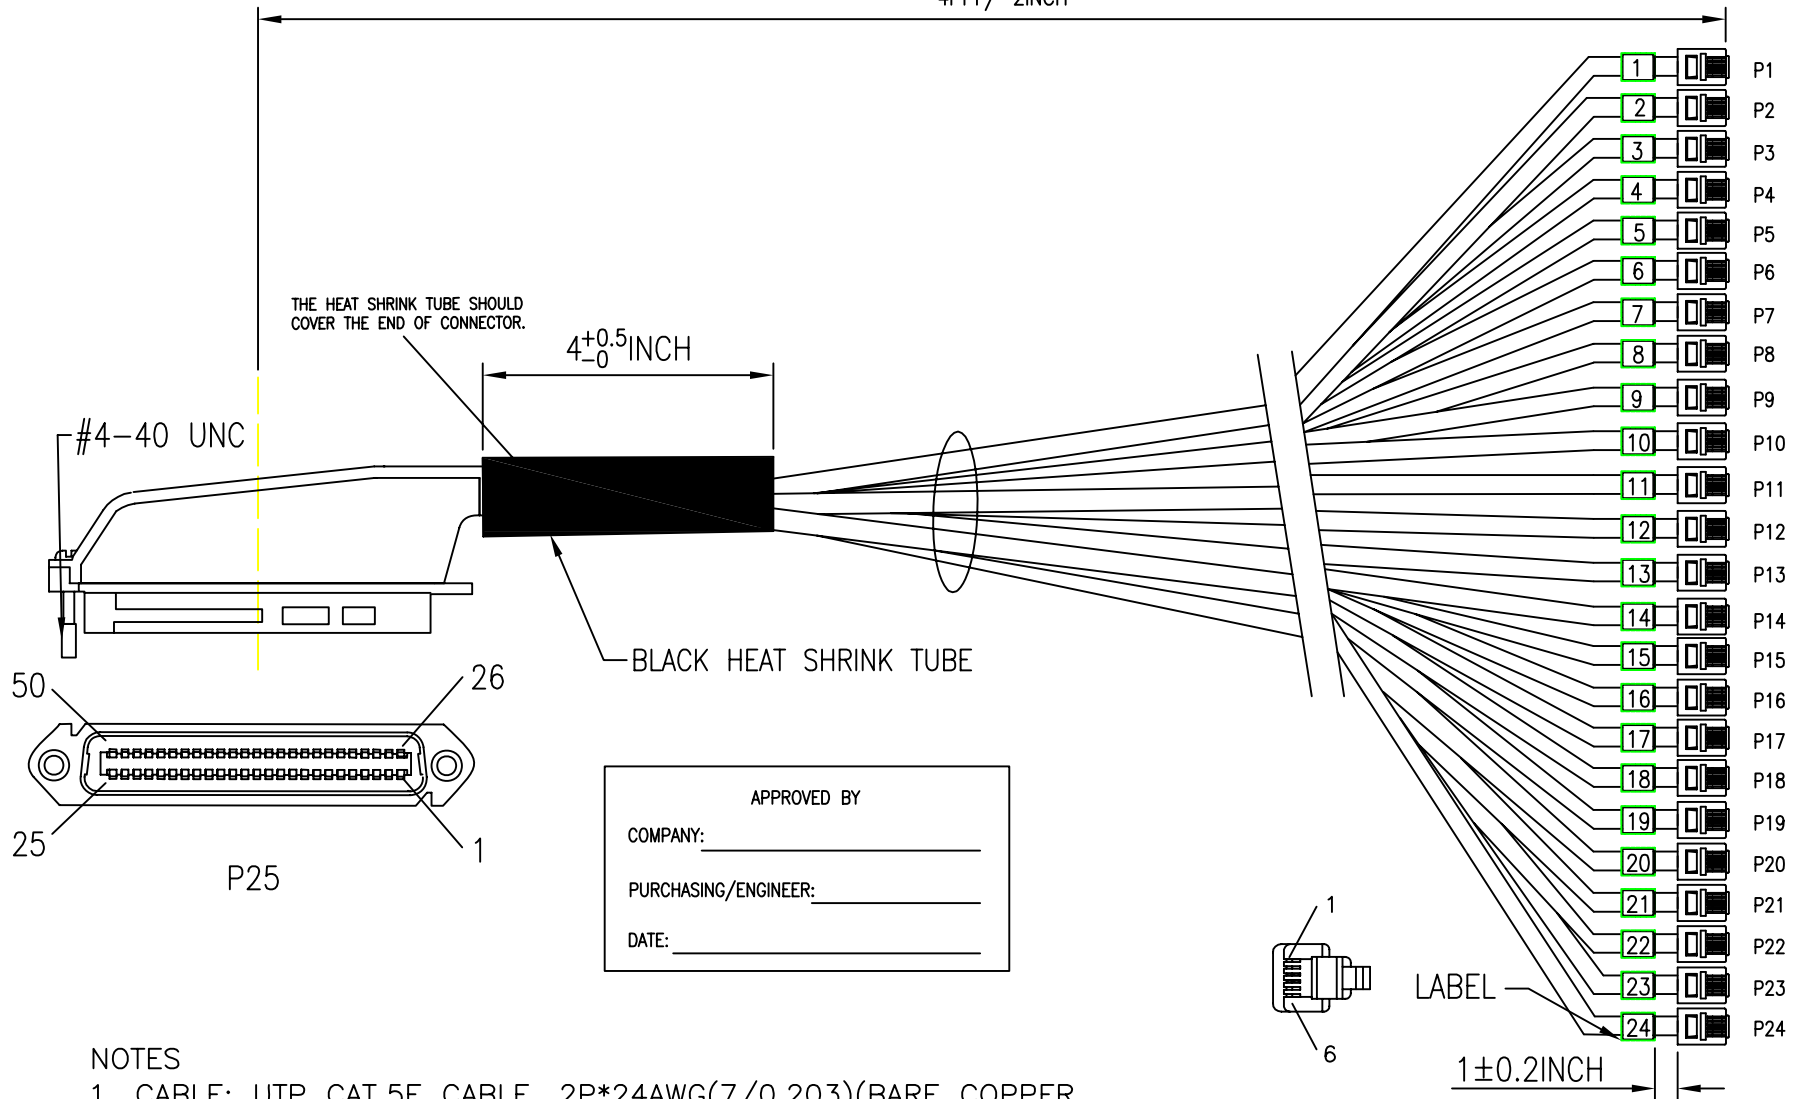

APPROVED BY _____
 COMPANY: _____
 PURCHASING/ENGINEER: _____
 DATE: _____



NOTES

1. CABLE: UTP CAT.5E CABLE. 2P*24AWG(7/0.203)(BARE COPPER, INSULATION: HD-PE.)+OUTER JACKET: GRAY PVC. OD: 4.5±0.15mm. P/N: 06F-R2P-T24-GY.
2. CONN. P25: TELCO 50PIN MALE: IDC TYPE, GOLD FLASH CONTACTS COLOR: BLACK. AMP P/N: 229974-1 P1~P24: RJ11 6P2C PLUG, G/F 2~3U”(060-F62-TF).
3. PLASTIC HOOD: P1: 90°, AMP P/N: 552560-1.
4. CABLE ASS'Y MUST PASS CONTINUITY TEST.

B						
A	INITIAL RELEASE				12/10/08	
REV	DESCRIPTION OF CHANGE				DATE	
TOLERANCE INCHES			M/M			Tri-Net Technology, Inc. http://www.trinetusa.com
.X	.015	.30	SCALE	NONE	REV A	
.XX	.010	.10	UNIT	MM		
.XXX	.005	.05	SHEET	1/2	DWG NO.	
DRAWN BY	Selina		DATE	12/10/08		
CHECK BY			TITLE	TELCO50M TO 6P2C PLUG		
APPD BY			PART NO.	035-224-M9-62-U-04-GY		



PIN OUT

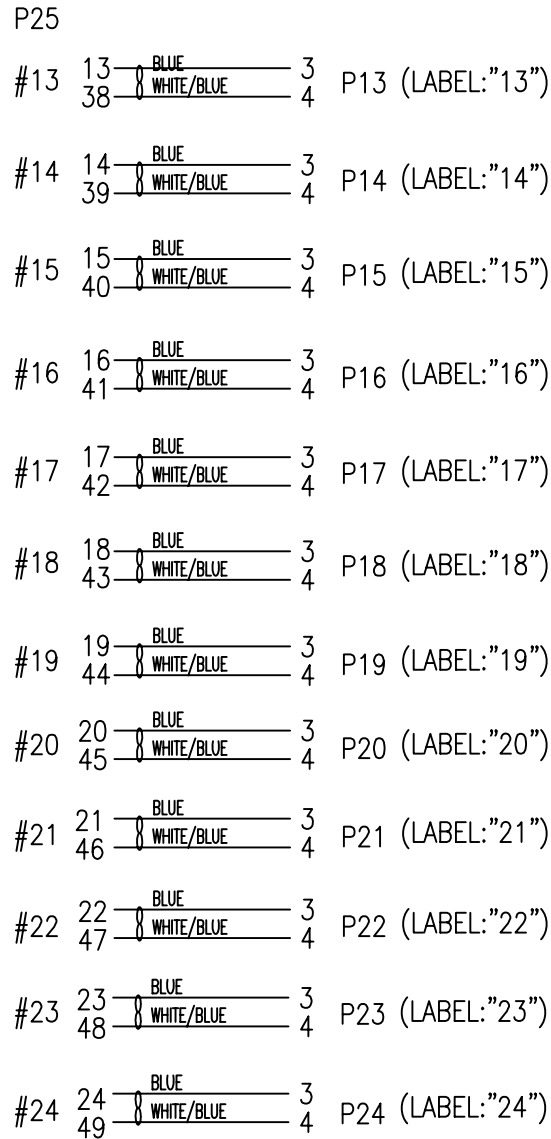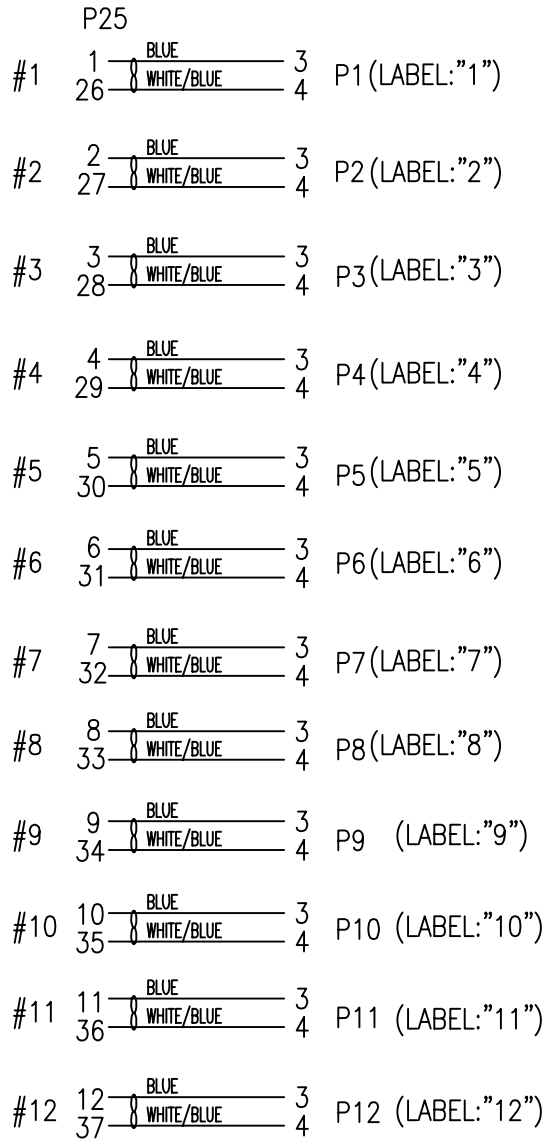

25 ————— OPEN
50 ————— OPEN

APPROVED BY	
COMPANY:	_____
PURCHASING/ENGINEER:	_____
DATE:	_____

B					
A	INITIAL RELEASE				12/10/08
REV	DESCRIPTION OF CHANGE				DATE
	TOLERANCE		Tri-Net Technology, Inc. http://www.trinetusa.com		
		INCHES	M/M		
	.X	.015	.30	SCALE	NONE
	.XX	.010	.10	UNIT	MM
	.XXX	.005	.05	DATE	12/10/08
DRAWN BY	Selina		SHEET	2/2	DWG NO.
CHECK BY			TITLE	TELCO50M TO 6P2C PLUG	
APPD BY			PART NO.	035-224-M9-62-U-04-GY	

